


ETL Intertek Testing listed to UL924 Standard for Emergency Lighting

**Photoluminescent  
100-foot viewing distance EXIT Sign**

Item-No:	Description:	Dimensions:
<b>600100RED</b>	100 foot viewing distance energy-efficient Photoluminescent EXIT Sign: 15-7/8" x 8-5/8" x 3/8" <b>Red</b> Plastic body with photoluminescent yellowish letters EXIT plus two chevrons inside the packing unit [< >].	
<b>600100GREEN</b>	<b>Green</b> Plastic body with photoluminescent yellowish letters EXIT plus two chevrons inside the packing unit [< >].	
<b>600100BLACK</b>	Black Plastic body with photoluminescent yellowish letters EXIT plus two chevrons inside the packing unit [< >].	

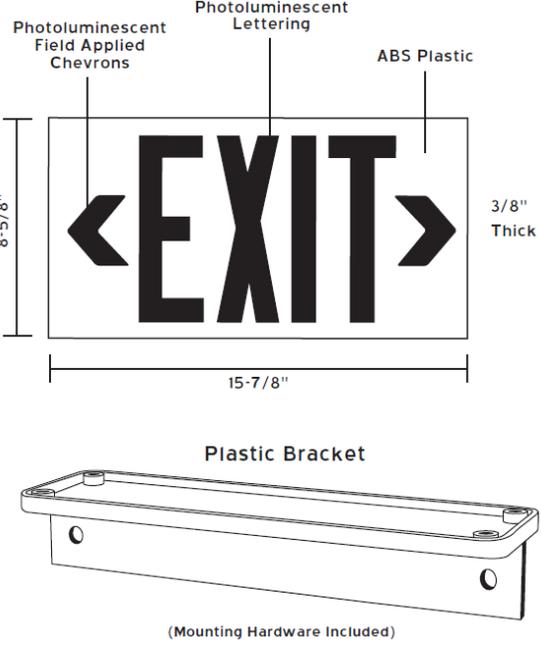

Also available DOUBLE-sided:  
Add -DB to Item-Number

## Compliances

### Photoluminescent Exit Sign

- ✓ In compliance with IBC and IFC codes
- ✓ In compliance with NFPA 101-*Life Safety Code*
- ✓ OSHA compliant
- ✓ Listed to Standard UL924 by ETL Intertek Testing
- ✓ Surface, flag, ceiling or stem mounted (hardware included). Before installation it must be determined that there is a minimum of 5 fc (54 lux) of fluorescent light on the face(s) of the sign at all times of building occupancy.
- ✓ Listed for high-location and floor-proximity installation

## Benefits

- No energy consumption: no electricity cost; green design
- No maintenance: no bulbs, no battery replacement
- Non-toxic, non-radioactive
- No disposal cost
- Easily movable, should egress routing change
- Thin, low profile construction
- Consistent, uniform illumination
- Visible at 100 feet
- Recyclable
- LEED points qualified
- Listed for outdoor/wet locations